


NOTE:

- 1.-Conductor from temporary service to transformer or secondary J box must be in a flexible conduit or direct bury type cable.
- 2.-Conductors must be long enough to enter under the base of the transformer and be connected to the secondary lugs of the transformer.
- 3.-The temporary service must be provided with all inspection covers in place before energizing service.
- 4.-Heber Light & Power is not responsible for damaged temporary services such as faulty breakers, or outlets.
- 5.-Temporary is required to be inspected by local building inspector before Heber Light & Power will make the temporary electrical connection.

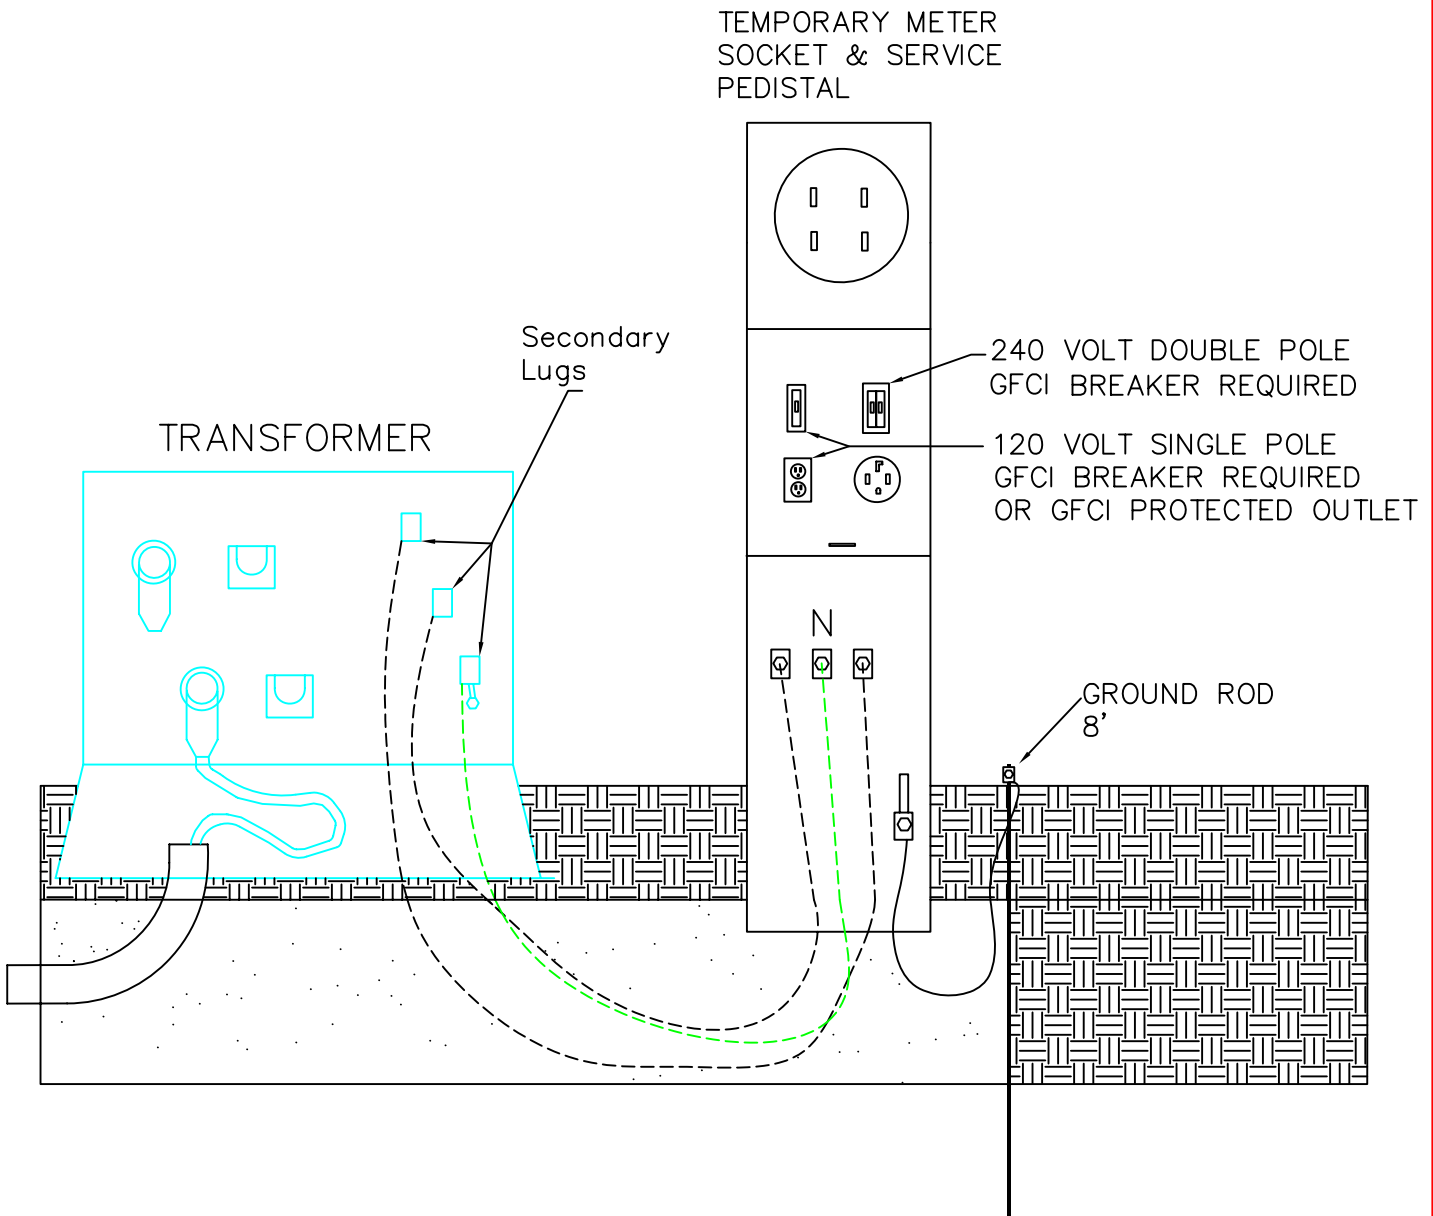

UNDERGROUND TEMPORARY SERVICE
(SUPPLIED BY OWNER OR ELECTRICIAN)

DATE: 01/25/2005

TEMPORARY
SERVICE
INSTALLATION

